



Office Sub Divisional Engineer, W/S & Sanitation

Sub Division Garhdiwala, Hoshiarpur

E-mail:- sdewss.garhdiwala@yahoo.com

No. 479

Dated: 25/05/2026

SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

To
The Principal,
Akai Academy Dhugga Kalan,
City Garhdiwala, District Hoshiarpur

No. 479 Date 25/5/2026

Subject:- Safe Drinking Water and Sanitation Condition Certificate

Ref:- Your application no. AADHK/80/1041/3/Gen.Letter Dated 21.05.2026

It is certified that an inspection team headed by Sr. Maninder Savra

(Name of Officers with designation) from Maninder Savra (J.E) W/S & Sanitation Sub-Div, Garhdiwala


(Name of Department/Office) inspected the Office Sub Division, W/S & Sanitation

(Name & Address of the school) Akal Academy Dhugga Kalan, Village & Post Office Dhugga Kalan

(Date of inspection), 10.5.2026

Checked the water test report submitted by the school and found that the school has potable drinking water for students and staff of the institution and is having provision for running water in the toilets and maintaining hygienic sanitation condition in the school building & the campus as per norms prescribed by the State Govt.

D/A 1 Test Report.


Sub Divisional Engineer
Water Supply and Sanitation
Sub Division Garhdiwala

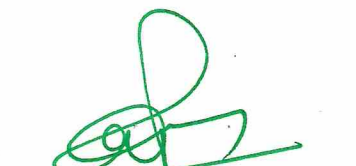
Signature with Seal: 

Name: Vikas Saini

Sub Divisional Engineer
W/S & Sanitation Sub-Div,
Garhdiwala

A copy of the above is forwarded to the Executive Engineer, W/S & Sanitation, Division No. 2, Hoshiarpur for information


Manager
Akal Academy
Dhugga Kalan (Hsp.)


Sub Divisional Engineer
W/S & Sanitation Sub-Div,
Garhdiwala

Signature with Seal:

Name: Vikas Saini

Sub Divisional Engineer
W/S & Sanitation Sub-Div,
Garhdiwala

REGIONAL WATER TESTING LAB, HOSHIARPUR

Government ITI, Jalandhar Road, Hoshiarpur
rwtlhsp@gmail.com

To,

Akal Academy Dhugga Kalan
Dhugga Kalan, Hoshiarpur


No.: RWTLHSP/2627/00182 Dated : 18/05/2026

Subject : Testing Reports of Water Samples.

Reference: Your Letter/SRF No. AADHK/80/1042/3/Gen.Letter Dated: 12/05/2026

As per above cited subject and reference, Please find enclosed here with the report of 1 Water sample/s received on dated 16/05/2026. It is request to fill the attached feedback form and send it back to Regional Water Testing Lab, Hoshiarpur

D/A : 1 Test Report



Authorized Signatory
For, Regional Water Testing Lab
Hoshiarpur



Manager
Akal Academy
Dhugga Kalan (Hsp.)



Principal
Akal Academy
Dhugga Kalan (Hoshiarpur)

REGIONAL WATER TESTING LAB, HOSHIARPUR

Government ITI, Jalandhar Road, Hoshiarpur
rwthlsp@gmail.com



TC-17758

TEST REPORT

Name & Address of Customer : Akai Academy Dhugga Kalan Dhugga Kalan, Hoshiarpur	Customer Reference No. No : AADHK/80/1042/3/Gen.Letter Dated : 12/05/2026
	Sample Submitted by Harpreet Singh
	Date of Sample Receipt 16/05/2026
	Analysis Starting Date 16/05/2026
	Analysis completion Date 18/05/2026
Discipline : Chemical Testing	Group: Water
ULR No.: TC17758260000079F	Sample Type : Water
Test Report No.: RWTLHSP/2627/00182	Date of Issue : 18/05/2026
Registration no.: RWTLHSP/REG2627/00607	Condition of Sample : Unsealed
Collection Point: Private Submersible	Quantity/Type of Bottle: 1000 ml / Transparent Plastic Bottle
Scheme/Source: Not Mentioned(Not Mentioned)	Location/Depth : Akai Academy Dhugga Kalan / NA
Village : Dhugga Kalan	Habitation : Dhugga Kalan
Block: Bhunga	District : Hoshiarpur
Latitude : Not Mentioned	Longitude: Not Mentioned

As per IS-10500:2012 (2nd Rev.)

Sr. No	Parameter	Result	Acceptable Limit	Permissible Limit	Unit	Reference Method :
1	pH	7.71@25°C	6.5-8.5	No Relaxation	--	IS 3025 (Part 11-2022) Electrometric Method
2	Colour	1	5	15	CU	IS 3025(Part 4-2021) Visual Comparison Method
3	Odour	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 5 – 2018) (Second Revision)
4	Taste	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 8 – 2023)
5	TDS	241.0	500	2000	mg/l	IS 3025 (Part 16-2023) Gravimetric Method
6	Turbidity	BDL	1	5	NTU	IS 3025 (Part 10-2023) Nephelometric Method
7	T. Alkalinity(CaCO3)	202.0	200	600	mg/l	IS 3025 (Part 23-2023) Indicator Method
8	T. Hardness(CaCO3)	168.76	200	600	mg/l	IS 3025 (Part 21- 2009)(RA 2023) EDTA Method
9	Calcium(Ca)	43.99	75	200	mg/l	IS 3025 (Part 40-2024) EDTA Titrimetric Method
10	Magnesium(Mg)	14.29	30	100	mg/l	APHA (24th Ed.2023) Method: 3500-Mg+2 B By Calculation Method
11	Chloride(Cl)	14.19	250	1000	mg/l.	IS 3025 (Part 32-2025) Argentometric Method

This Report is issued under the following terms & Condition :

1. The results apply to the sample as received only.
2. The sample will be destroyed after retention time unless otherwise specified specially.
3. This report is not to be reproduced wholly or in part and can't be used as evidence in court of law.
4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected, T=Total)
5. * Value not available or test not performed for this parameter.
6. Temperature condition limit: 25±5°C and Humidity condition limit:50 ±20%

Reviewed and Approved By

Abhishek Joshi
Sr. Chemist
Authorized Signatory
For, Regional Water Testing Lab
Hoshiarpur

End of the Test Report

(Signature)
Manager
Akai Academy
Dhugga Kalan (Hospiarpur)

(Signature)
Manager
Akai Academy
Dhugga Kalan (Hoshiarpur)

REGIONAL WATER TESTING LAB, HOSHIARPUR

Government ITI, Jalandhar Road, Hoshiarpur
rwtlhsp@gmail.com

TEST REPORT	
Name & Address of Customer : Akai Academy Dhugga Kalan Dhugga Kalan, Hoshiarpur	Customer Reference No. No : AADHK/80/1042/3/Gen.Letter Dated : 12/05/2026 Sample Submitted by Harpreet Singh Date of Sample Receipt 16/05/2026 Analysis Starting Date 16/05/2026 Analysis completion Date 18/05/2026
Discipline : Bacteriological Testing ULR No.:	Group: Water Sample Type : Water
Test Report No.: RWTLHSP/2627/00182	Date of Issue : 18/05/2026
Registration no.: RWTLHSP/REG2627/00607	Condition of Sample : Unsealed
Collection Point: Private Submersible	Quantity/Type of Bottle: 1000 ml / Transparent Plastic Bottle
Scheme/Source: Not Mentioned(Not Mentioned)	Location/Depth : Akai Academy Dhugga Kalan / NA
Village : Dhugga Kalan	Habitation : Dhugga Kalan
Block: Bhunga	District : Hoshiarpur
Latitude : Not Mentioned	Longitude: Not Mentioned

Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	Total Coliform(TC)	ABSENT	Shall not be detectable in any 100 ml sample	No relaxation	---	IS 15185 Membrane Filtration Method
2	E-Coli	ABSENT	Shall not be detectable in any 100 ml sample	No relaxation	---	IS 15185 Membrane Filtration Method

This Report is issued under the following terms & Conditions :


1. The results apply to the sample as received only.
2. The sample will be destroyed after retention time unless otherwise specified specially.
3. This report is not to be reproduce wholly or in part and can't be used as evidence in court of law.
4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected, T=Total)
- 5 * Value not available or test not performed for this parameter
6. Temperature condition limit, 25±5°C and Humidity condition limit 50 ±20 %

Reviewed and Approved By

Abhishek Joshi
Sr. Chemist
Authorized Signatory
For, Regional Water Testing Lab
Hoshiarpur

End of the Test Report


Manager
Akai Academy
Dhugga Kalan (Hsp.)


Principal
Akai Academy
Dhugga Kalan (Hoshiarpur)